


October 2021: Continuous Monitoring Program



October 2021: Continuous Monitoring Program

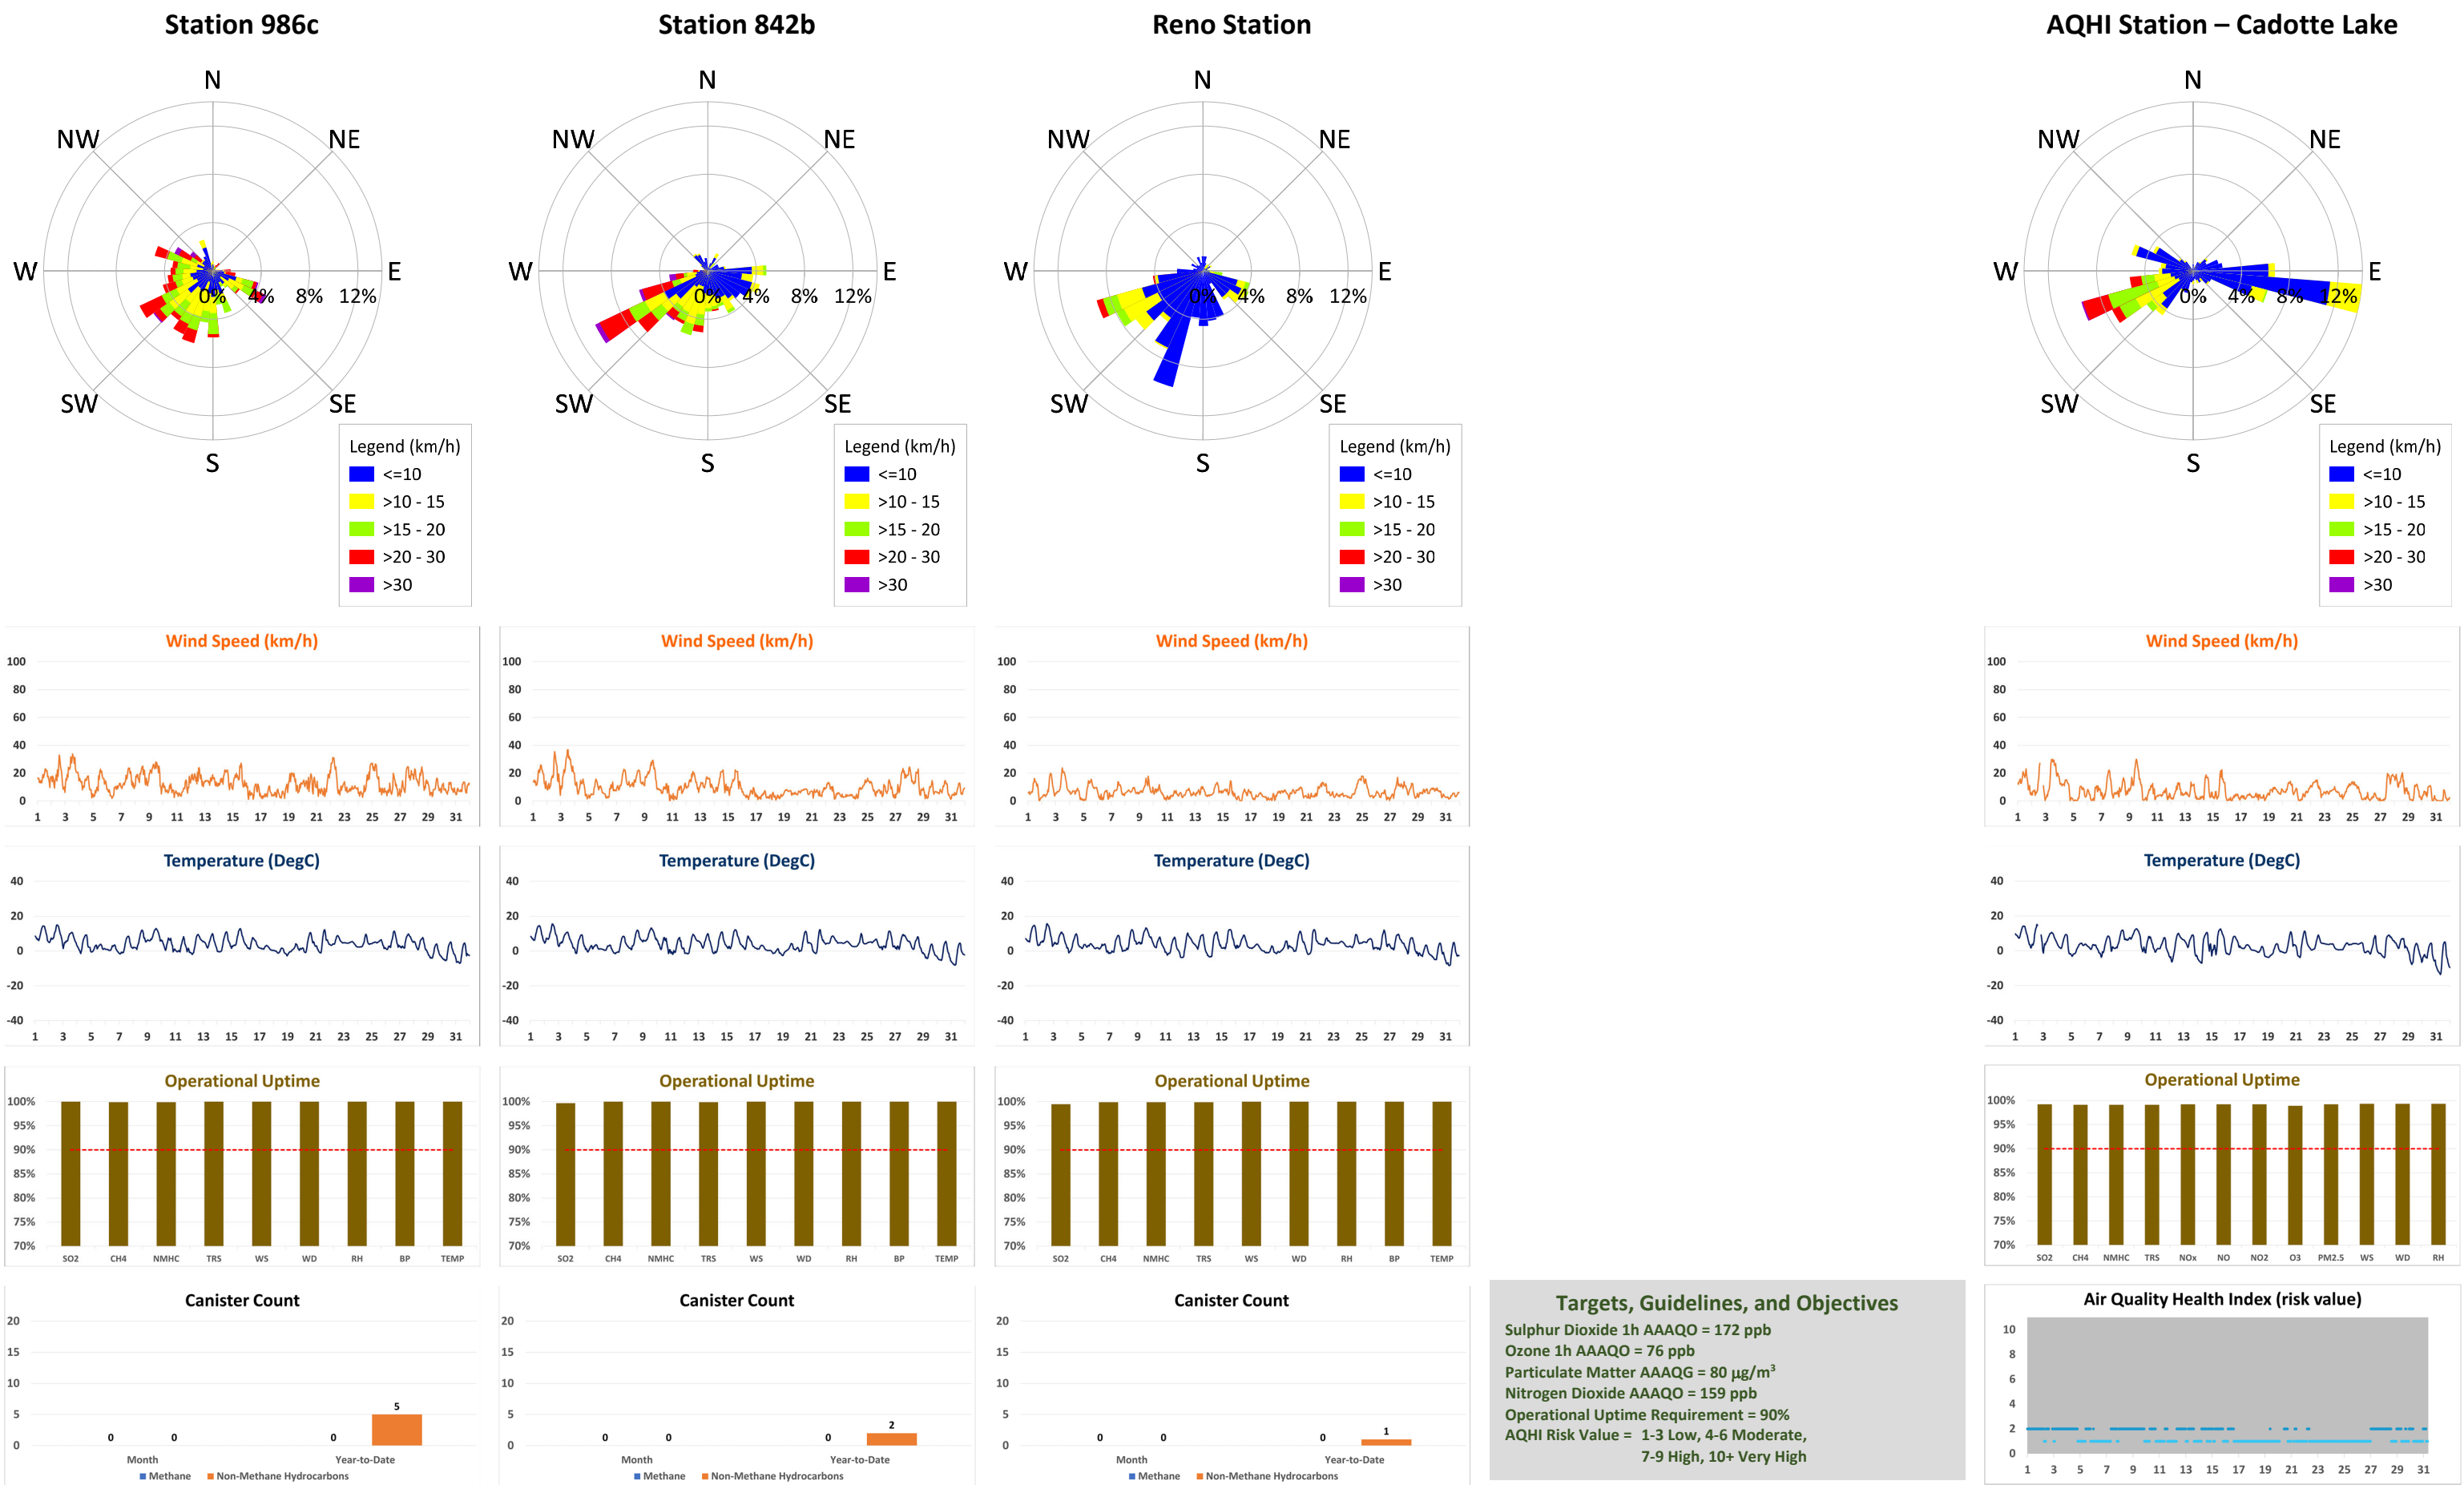

Targets, Guidelines, and Objectives

Sulphur Dioxide 1h AAAQO = 172 ppb
Ozone 1h AAAQO = 76 ppb
Particulate Matter AAAQG = 80 µg/m³
Nitrogen Dioxide AAAQO = 159 ppb
Operational Uptime Requirement = 90%
AQHI Risk Value = 1-3 Low, 4-6 Moderate, 7-9 High, 10+ Very High